

WIRING DIAGRAM

R6GN-150*/180* Series


1. Remove white wire from Power Block terminal (L3) and connect to Autotransformer red wire.
2. Wires attached to normally closed contacts of auxillary switch.
3. Connect to mixed air sensor when equipped with economizer.

208-230/460 Volt AC

4. For 208V applications, remove wire tap from 240V location on transformer and replace onto 208V tap.
5. Orange wire connects to #2 terminal on compressor lockout and replaced by red #3 wire.
6. Connects to ignition control 24VAC with no overload present.

Three Phase 60 Hz.

1. Couper le courant avant de faire letretien.
2. Employez uniquement des conducteurs en cuivre.

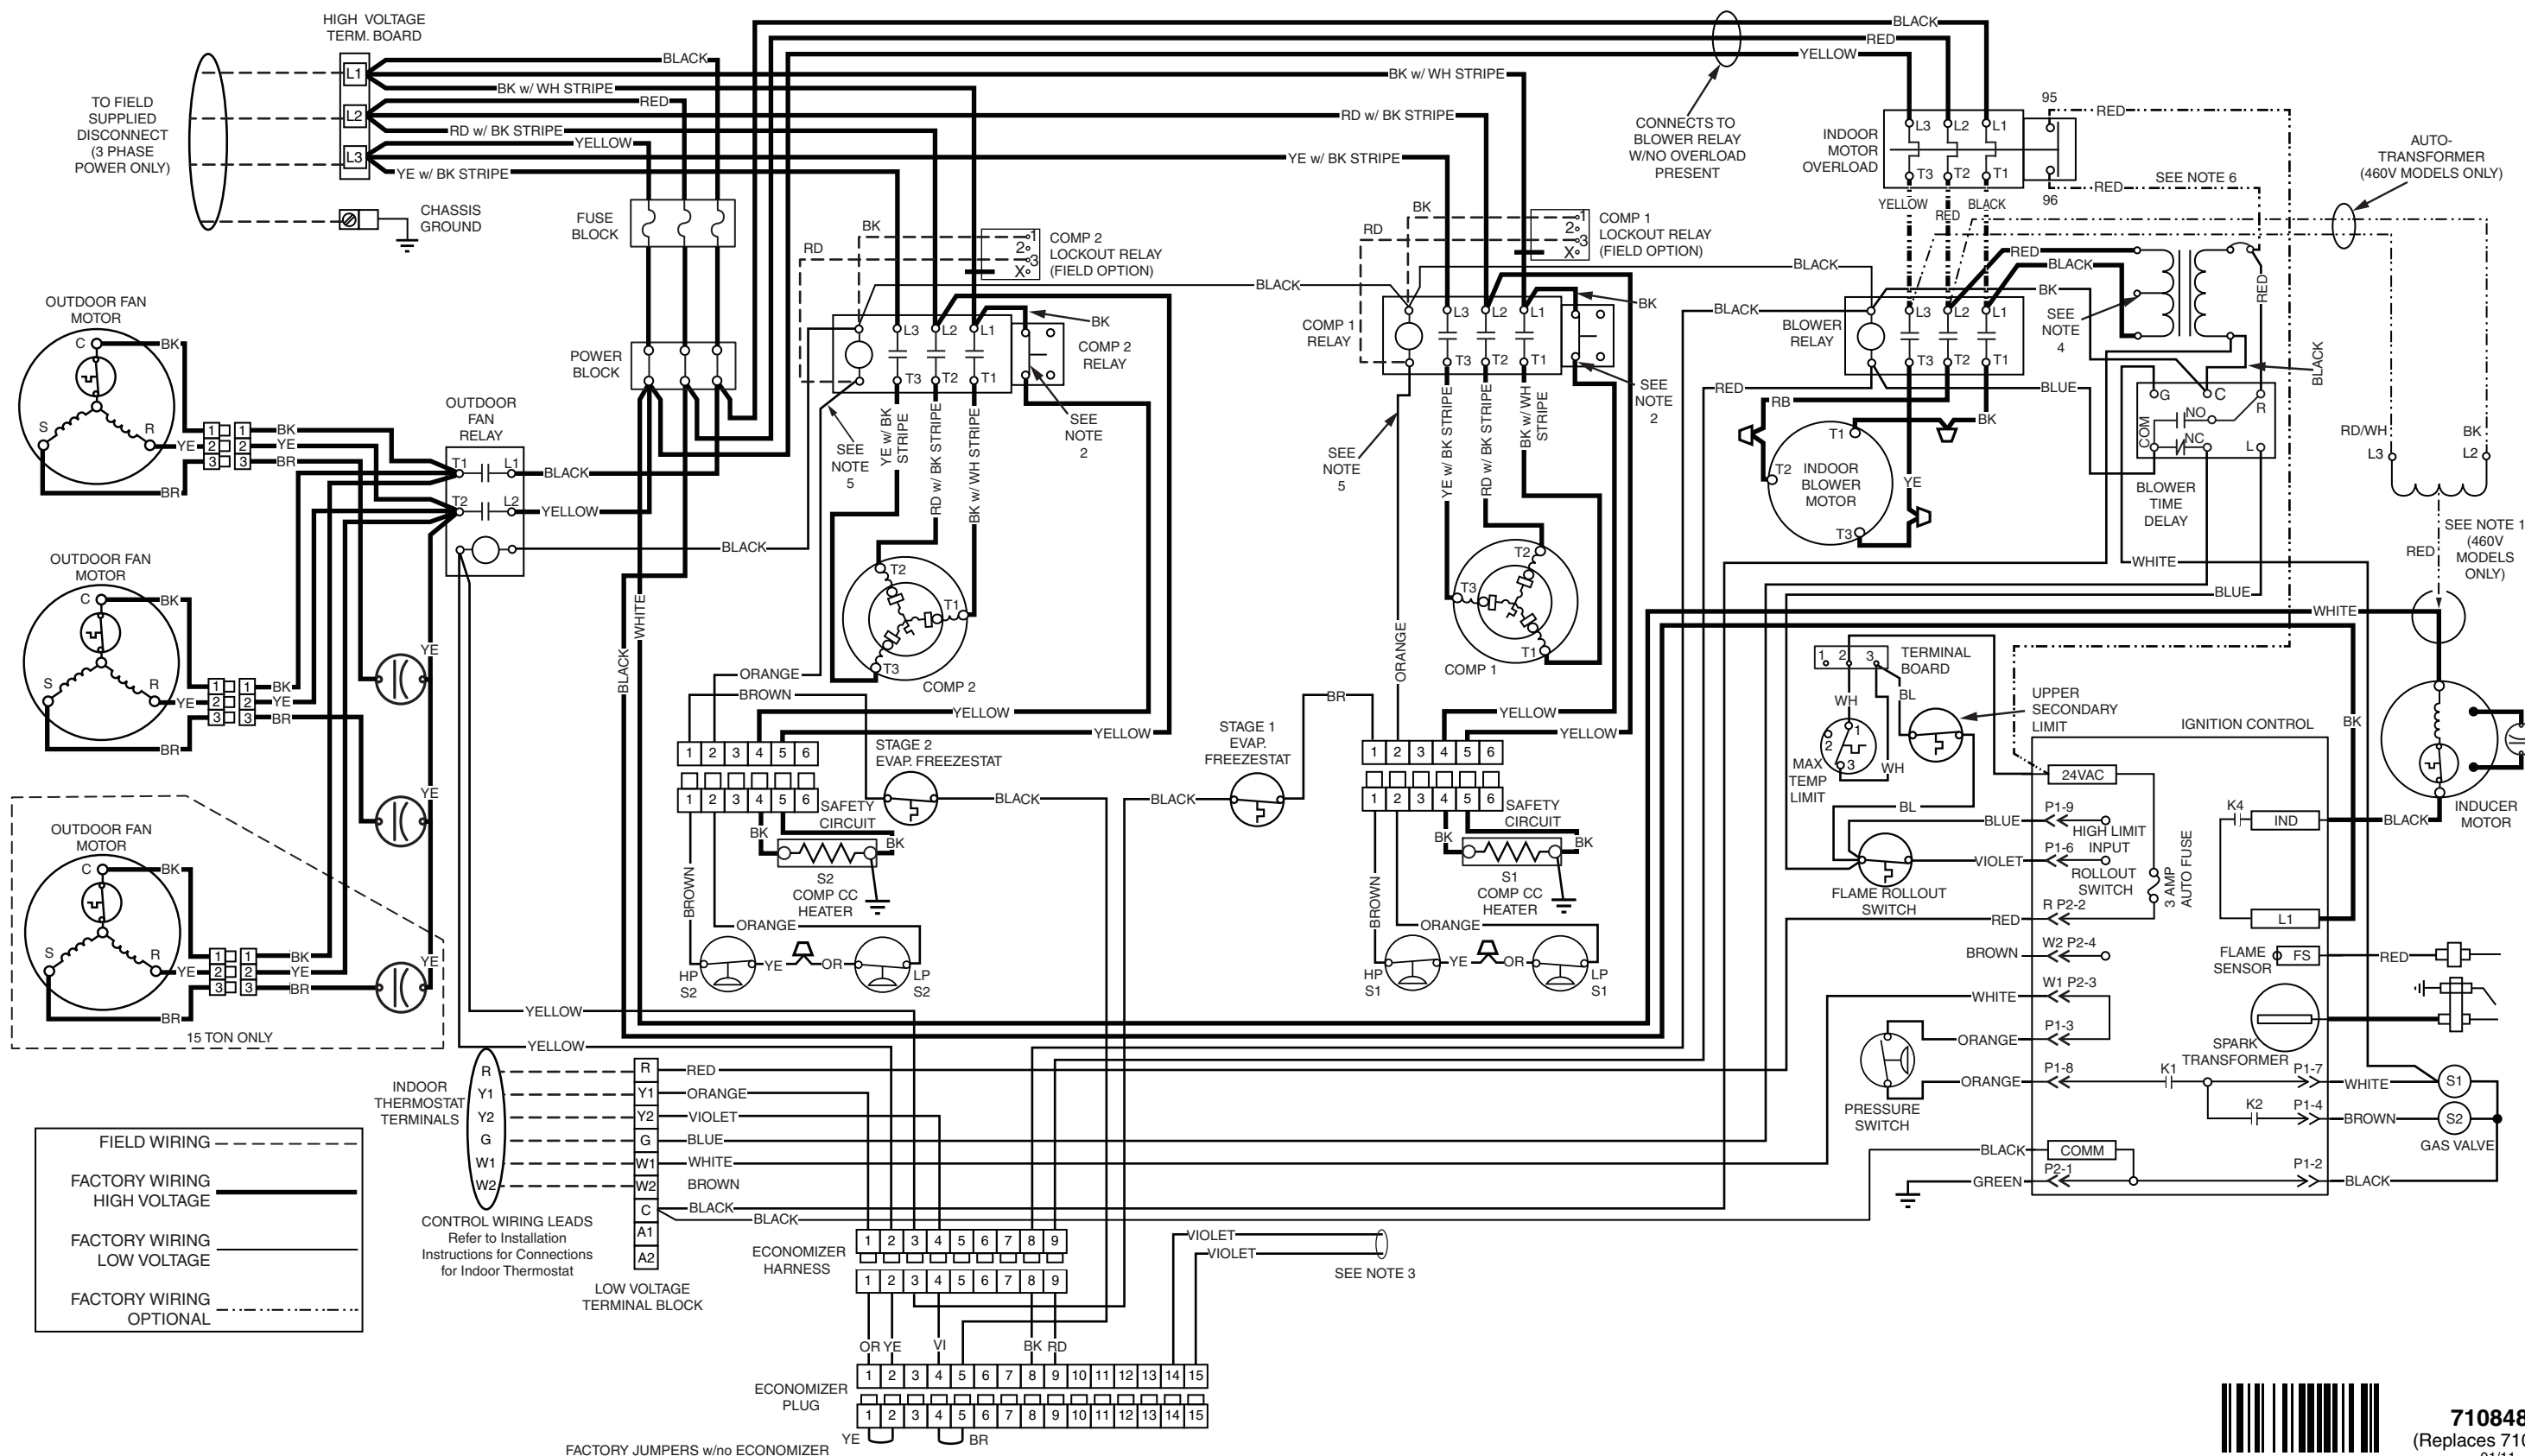

710848A
(Replaces 7108480)
01/11