


Pilot Needle Valve Conversion Kit

Applies: RDF Models

Kit, P/N 112645, includes:

Code	Qty	P/N	Description
1	1	112710	Needle valve & spring assembly includes: <ul style="list-style-type: none"> Needle valve Nupro B-4JNR, P/N 112462 2" long aluminum tubing, P/N 112711 (installed on inlet side)
2	1	93388	Brass elbow, 1/8"NPT x 1/4" (includes nut and ferrule)
3	1	112644	Pilot regulator, Maxitrol 325-3

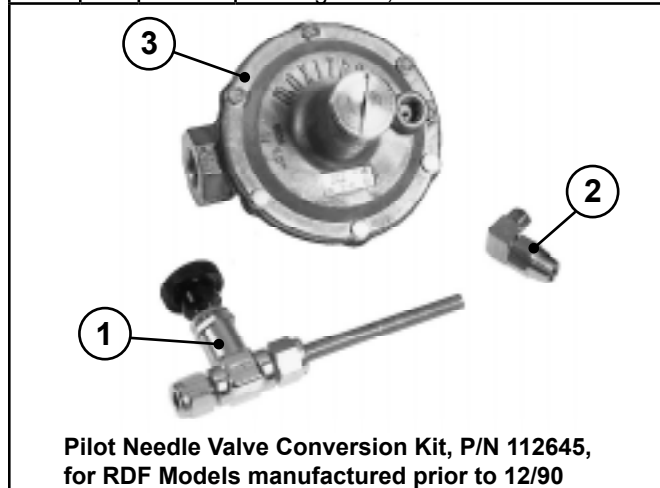

Description / Application

This kit was developed to correct the problem of gas surges through the pilot valve. If surges of pilot gas are a problem, the addition of the needle valve and the replacement regulator in this kit will provide a better regulated flow of gas to the pilot. This kit applies to RDF units manufactured prior to December, 1990.

Installation Instructions:

1. Turn off the gas supply to the unit.
2. Turn off the electrical power to the unit.
3. Remove the Pilot Regulator - Remove the electrical burner control compartment service panels. Locate the pilot valve and the pilot regulator (See Figures 1A, 1B & 1C).

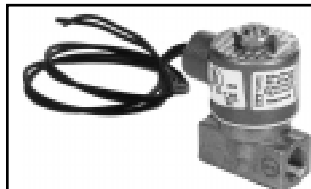


Figure 1A - Pilot Valve
GC #311AF02N6 (P/N 86967)
will be installed



Figure 1B - Original Pilot Regulator, Maxitrol #R400S
being replaced by P/N 112644 - Item 3 above

Disconnect the 1/4" pilot tubing from both the pilot valve and the pilot regulator. On the pilot regulator, remove the 3/8" x 1/8" NPT hex bushing from the inlet side. Save this bushing as it will be used when installing the new pilot regulator.

Remove the two sheetmetal screws attaching the pilot valve bracket to the heater panel. (Pilot valve is still sitting on the bracket and wiring to the pilot valve is in tact. Save the screws to re-attach the bracket). The pilot valve/pilot regulator assembly is now loose from the heater panel.

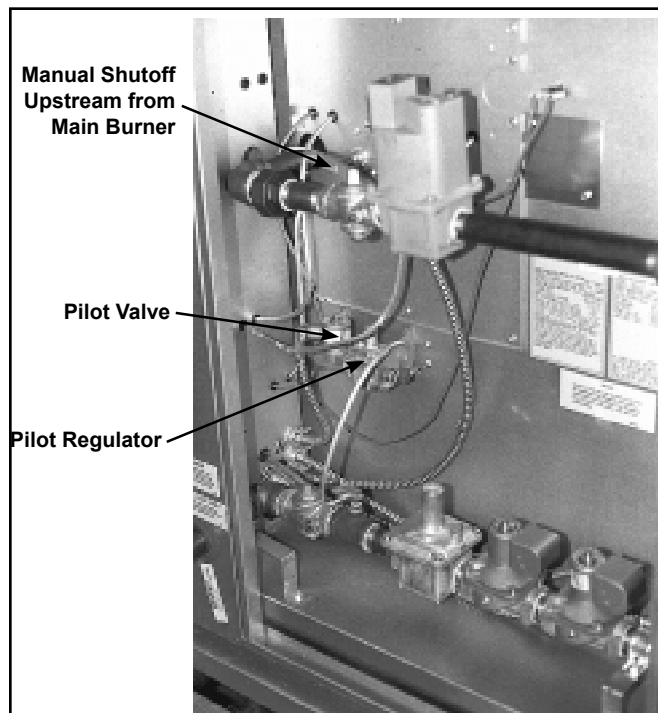


Figure 1C - Burner Control Compartment
(arrangements vary with type of manifold option selected)

Loosen the 3/8" close nipple between the pilot regulator and the pilot valve. Remove the pilot regulator, leaving the close nipple attached to the pilot valve.

4. Install the new Pilot Regulator - Place a small amount of pipe thread compound on the 3/8" close nipple attached to the pilot valve. Check the direction of the flow arrow on the bottom of the new pilot regulator (Maxitrol 325-3). With the flow arrow pointing toward the pilot valve, thread the new pilot regulator on to the close nipple.

While the pilot valve/pilot regulator assembly is still detached from the heater panel, remove the 90° brass fitting from the outlet side of the pilot valve (This fitting will not be re-used). Replace the fitting with the fitting included in the kit. The new fitting includes a nut and ferrule tubing connection.

The 3/8" hex bushing removed from the old regulator serves a dual purpose. It is not only a connection but, also the method of attaching the regulator to the mounting bracket. Apply a small amount of pipe thread compound on the 3/8" NPT hex bushing, insert it through the hole in the bracket and thread it into the pilot regulator (**NOTE:** Depending on the manifold arrangement, the pilot valve assembly may have to be relocated slightly to allow room for the addition of the needle valve. Before re-attaching the pilot valve bracket, position the bracket assembly and hold the new needle valve at the fitting on the outlet side of the pilot valve. If a position adjustment is necessary, remove the screws from the regulator bracket and adjust the position of the assembly to allow for the needle valve. Mark and drill the four new holes. (Re-attach the bracket(s) with sheetmetal screws).

Re-connect the 1/4" pilot tubing to the bushing on the inlet side of the newly installed pilot regulator.

5. Install Needle Valve - The needle valve comes pre-assembled to a short piece of aluminum tubing. To attach the needle valve to the pilot valve, place the end of that aluminum tubing into the nut and ferrule on the new brass fitting attached to the outlet side of the pilot valve. Tighten

this connection.

Using tubing cutters, remove the old nut and ferrule from the 1/4" pilot line. Remove any burrs from the end of the tubing. Connect the tubing to the needle valve using the nut and ferrule fitting on the needle valve. (**NOTE:** To provide proper connection, the nut and ferrule supplied with the needle valve must be used).

6. Adjust the Pilot Regulator and the Needle Valve/Leak Test/ Verify Pilot Flame Adjustment/Check Operation (FOLLOW ALL STEPS IN SEQUENCE).

- 1) Close all service panels except for the electrical and burner control compartment doors.
- 2) Adjust Regulator/Needle Valve - Adjust the pilot regulator seven complete turns counterclockwise from the maximum outlet pressure (completely close). Adjust the needle valve two complete turns counterclockwise from the completely closed position.
- 3) Check for Pilot Line Leaks:
 - a) Set the blower service switches and the burner service switch to "TEST" positions. (Switches are in the electrical compartment). (**NOTE:** Placing blower and burner service switches in the "TEST" position is necessary to safely override the control from the remote console when the electrical power is on at the disconnect switch).
 - b) Turn on the electrical power to the unit.
 - c) Close the manual shutoff valve immediately upstream from the main burner. (see **Figure 1C**)
 - d) Turn on the gas supply to the unit.
 - e) Using a leak-detecting solution, check all connections in the pilot line. Correct any leaks.

WARNING: Never test for gas leaks with an open flame. Failure to comply could result in severe personal injury, property damage or death.

- 4) Check Length of Pilot Flame - (2 persons recommended)
Since the gas pressure in the pilot line will vary depending upon the size of the unit and the airflow across the burner it is necessary to verify that the "standard" adjustments made in step 2 are correct for your installation. The only way to do this is by visually checking the length of the pilot flame.
 - a) Turn off the electric power to the unit.
 - b) Set the blower service switch and the burner service switch to "OFF" positions.
 - c) On the side of the blower compartment opposite the burner controls (the pilot flame is not visible from the control side), remove the blower compartment door panel. Because the pilot flame will be affected if the door is completely open, it is necessary to remove the lower door panel, leaving approximately a 1" opening across the top.

CAUTION: When the blower energizes, the "loosened" door panel will be drawn to the cabinet. If holding the panel in position, do not put fingers between the door panel and the cabinet.

- d) Turn on the electrical power to the unit.
 - e) Set the blower service switch and the burner service switch to the "TEST" position.
 - f) Looking through the opening across the top of the blower compartment door panel, visually check the length of the pilot flame. The flame should be between 2 and 4 inches. If the pilot flame is within this range, no further adjustment is required. If not, make adjustments to the pilot regulator and/or the needle valve until the proper flame height is achieved.
- 5) Restore the unit to normal operation.
- a) Turn off the electrical power to the unit.
 - b) Set the blower and burner service switches to the "OFF" positions.
 - c) Open the manual shutoff valve immediately upstream from the main burner.
 - d) Set the blower service and burner service switches to the "RUN" position.
 - e) Close all service panels.
 - f) Turn on the electrical power to the unit.
 - g) Installation of the conversion kit is complete and the unit is restored to normal operation. Test the unit with the remote console to verify proper operation.

www.ReznorHVAC.com; (800) 695-1901

©2015 Reznor LLC. All rights reserved.

Trademark Note: Reznor® is registered in at least the United States.

Form CP-RDF-PNV (08-15) P/N 112646

REZNOR®

Form CP-RDF-PNV (08-15), P/N 112646, Page 2